

FIRE FACT NO. 017 CHECKLIST(s): 99


TITLE: EXTERIOR STAIR PROTECTION AND SUPPORT

CHECKLIST ITEM(s): 99-07, 08


REFERENCE(s): 91-101/5-2.2.6.3, K.S.A. 31-133(a)

PAGE 1 of 1


FOLLOWING ARE EXTERIOR STAIRS SHOWING THE TYPES OF PROTECTION OR SUPPORT REQUIRED.

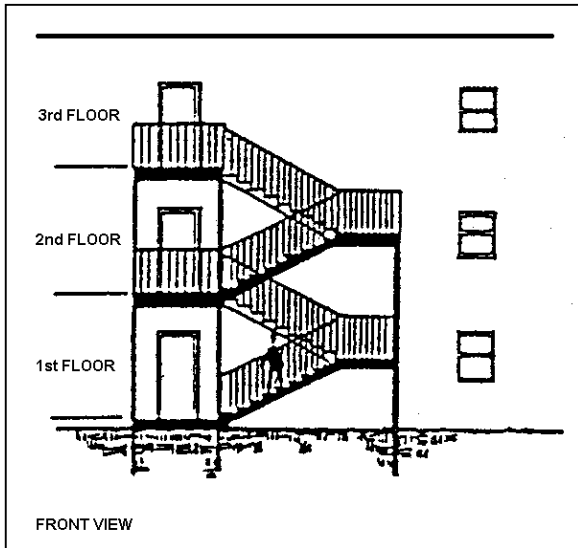

3-STORY OR LESS. NO PROTECTION REQUIRED UNLESS EXPOSED TO NARROW COURTYARD.

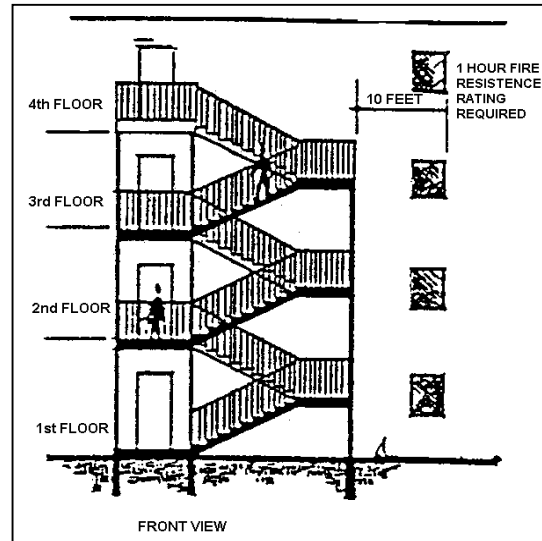

4-STORY OR MORE. REQUIRES 1-HR FIRE RESISTIVE WALLS AND  $\frac{3}{4}$ -HR OPENING PROTECTION (WIRED GLASS IN FIXED METAL FRAMES) WITHIN 10 ft. OF COMPLETE LENGTH OF STAIRS.

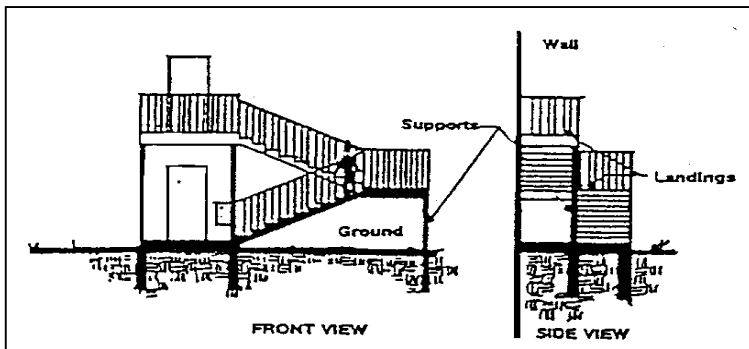

FIRE ESCAPE STAIRS MUST BE STRUCTUALLY SUPPORTED TO THE GROUND, OR DOCUMENTATION MAINTAINED OF SUCCESSFUL INSPECTION BY LICENSED ARCHITECT OR ENGINEER UPDATED EVERY FIVE YEARS.

